


- NOTES:**
- 1. STEPS SHALL BE 4'-0" WIDE, CURB TO CURB, PLUS 6" CURBS ON EACH SIDE.
 - 2. CEMENT CONCRETE SHALL BE CLASS 4000 TROWEL FINISH.
 - 3. NUMBER OF STEPS SHALL SUIT INDIVIDUAL CONDITIONS, WITH TREAD AND RISER DIMENSIONS TO SUIT THE GRADE.
 - 4. RISERS SHALL BE 5" MINIMUM, 7" MAXIMUM:
TREAD SHALL BE 11" MINIMUM, 12" MAXIMUM.
 - 5. HANDRAIL REQUIRED ON BOTH SIDES PER BUILDING CODE STANDARDS.
 - 6. HANDRAIL MAY NOT ENCROACH INTO PUBLIC SIDEWALK

STANDARD DETAIL
CEMENT CONCRETE
STEPS

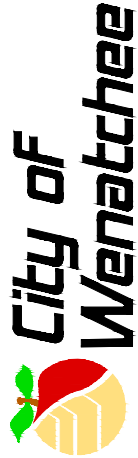

SCALE: AS SHOWN	DATE DRAWN		DATE		REVISIONS		DATE		REVISIONS	
	DESIGNED	DRAWN	CHECKED	APPROVED	DATE	INITIAL	DATE	INITIAL	DATE	INITIAL
		CAW			0/23/2020	AJS	01/01/2022			